



**RECREATIONAL HEALTH - OFFICIAL INSPECTION REPORT**

FACILITY NAME <b>SHADY TRAILS PARKHOUSE</b>			REINSPECTION DATE <b>Not Specified</b>		INSPECTOR <b>Yanan Zhu</b>	DATE <b>6/6/2016</b>
LOCATION <b>15977 PARKSIDE WY, FONTANA, CA 92336</b>			PERMIT EXPIRATION <b>8/31/2016</b>		IDENTIFIER: Pool SERVICE: 001 - INSPECTION - ROUTINE	
TIME IN <b>11:35 AM</b>	TIME OUT <b>12:30 PM</b>	FACILITY ID <b>FA0024697</b>	RELATED ID <b>PR0032112</b>	PE <b>3620</b>	RESULT: 05 - CORRECTIVE ACTION / FOLLOW UP REQU ACTION: 13 - PERMIT SUSPENDED / FACILITY CLOSED	

**RECREATIONAL HEALTH - Public Pool - Initial Pool at Facility**


Based on an inspection this day, the items marked below identify the violation(s) in operation or facilities which must be corrected. Failure to correct listed violation(s) prior to the designated compliance date may necessitate an additional inspection to be billed at the hourly rate as provided in the San Bernardino County Code, [Schedule of Fees](#).

**92**  
SCORE

Administrative Order to Show Cause (OSC): The Permittee has the right to a hearing if requested in writing within 15 calendar days of receipt of this notice, to show cause why the permit to operate should not be suspended or revoked; otherwise the right to a hearing shall be deemed waived.

See the following pages for the code sections and general requirements that correspond to each violation listed below.

Ideal
In Compliance
Not in Compliance

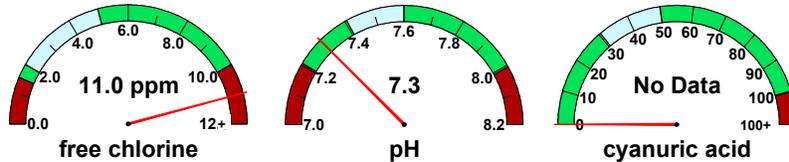

temperature (°F)	No Data
observed flow (gpm)	No Data
required flow (gpm)	No Data
volume (gal)	No Data
area (sq ft)	No Data
occupancy	No Data

**IMPORTANT: Replacement of Suction Outlet Covers**  
Suction Outlet covers (anti-entrapment covers over main drains and skimmer equalizer outlets) shall be replaced upon expiration. The expiration (in years) is stamped on the front of each cover, indicating the amount of time the cover is valid after installation. Each replacement cover shall:

1. Meet the latest ANSI/APSP-16 performance standard
2. Be rated for the maximum designed flow-rate of the pump

Retain all records which indicate the make/model number of the replacement cover and date of installation. Records shall be made available to your inspector upon request.

**36K995 Permit - Suspension** **⚠ CRITICAL ⚠**

<b>POINTS</b> <b>NA</b>	Compliance Date: <b>Not Specified</b> Not In Compliance Violation Reference - HSC	<b>Inspector Comments:</b> Observed free-chlorine residual to be high. The maximum concentration of disinfectant residual shall be 10.0 ppm free chlorine. Maintain free-chlorine level to be at 10 ppm or less. Minimum disinfectant residual shall be at minimum of 1 ppm without cyanuric acid or 2 ppm with cyanuric acid. The health permit to operate is hereby suspended and the pool ordered closed until the listed violation have been corrected and verified by Environmental Health Services (EHS). The facility is to remain closed until permission from EHS is given. Contact your inspector at your local office (800) 442-2283 to schedule a reinspection to reinstate the health permit.  The facility is posted closed; do not move, hide, or remove the sign. Reopening of the pool/spa without the approval by EHS, may result in an hourly billable Professional Services fee.
----------------------------	---	--

**Violation Description:** Violation(s) observed pose an immediate threat to public health and safety. The health permit to operate is hereby suspended and the pool/spa ordered closed until the listed violation(s) have been corrected and verified by Environmental Health Services (EHS). The facility is to remain closed until permission from EHS is given. Contact your inspector at your local office to schedule a reinspection to reinstate the health permit. The facility is posted closed; do not move, hide, or remove the sign. Reopening of the pool/spa without the approval by EHS, may result in an hourly billable Professional Services fee.

**36K502 Water Quality - Critical – Disinfectant level** **⚠ CRITICAL ⚠**

<b>POINTS</b> <b>5</b>	Compliance Date: <b>Not Specified</b> Not In Compliance Violation Reference - HSC - 65529	<b>Inspector Comments:</b> Observed free-chlorine residual to be high. The maximum concentration of disinfectant residual shall be 10.0 ppm free chlorine. Maintain free-chlorine level to be at 10 ppm or less. Minimum disinfectant residual shall be at minimum of 1 ppm without cyanuric acid or 2 ppm with cyanuric acid.
---------------------------	---	--

**Violation Description:** The minimum concentration of disinfectant residual in public pools shall be 1.0 ppm free-chlorine without cyanuric acid or 2.0 ppm free-chlorine with cyanuric acid. The minimum concentration of disinfectant residual in public spas, wading pools, and spray grounds shall be 3.0 ppm free-chlorine. The maximum concentration of disinfectant residual shall be 10.0 ppm free-chlorine.

The minimum concentration of bromine residual in public pools shall be 2.0 ppm. The minimum concentration of bromine residual in public spas, wading pools, and spray grounds shall be 4.0 ppm.

A spray ground and water features with an ultraviolet light disinfection system shall be disinfected continuously at a minimum of 40 mJ/cm2 by the ultraviolet light disinfection units while the spray ground and water features are in use. If the ultraviolet dosage rate drops below 40 mJ/cm2 the operator shall close the spray ground and water features.



**RECREATIONAL HEALTH - OFFICIAL INSPECTION REPORT**

FACILITY NAME <b>SHADY TRAILS PARKHOUSE</b>	DATE <b>6/6/2016</b>
LOCATION <b>15977 PARKSIDE WY, FONTANA, CA 92336</b>	INSPECTOR <b>Yanan Zhu</b>

**36K574 Maintenance – Test kit**

<b>POINTS</b> <b>1</b>	Compliance Date: <b>Not Specified</b>	<b>Inspector Comments:</b> Observed chemical test kit missing. The pool operator shall maintain a test kit for measuring the disinfectant residual, pH, and, if used, cyanuric acid concentration at the public pool. This test kit shall be available for use by the pool operator and the enforcing agent at all times the public pool is in use
	<b>Not In Compliance</b>	
	Violation Reference - <b>HSC - 65529</b>	

**Violation Description:** The pool operator shall maintain a test kit for measuring the disinfectant residual, pH, and, if used, cyanuric acid concentration at the public pool. This test kit shall be available for use by the pool operator and the enforcing agent at all times the public pool is in use. The chlorine or bromine test kit shall be the diethyl-p-phenylenediamine (DPD) type or otherwise be capable of testing free-halogen residual.

**36K582 Maintenance - Public pool site maintenance**

<b>POINTS</b> <b>1</b>	Compliance Date: <b>Not Specified</b>	<b>Inspector Comments:</b> Observed flow meter to be non-functioning. Replace/Repair pool flow meter.
	<b>Not In Compliance</b>	
	Violation Reference - <b>HSC - 65535</b>	

**Violation Description:** The pool operator shall keep all parts of the public pool site well-maintained, including, but not limited to, the public pools, water treatment systems, ancillary facilities, signs, showers, toilets, dressing facilities, drinking fountains, diaper-changing stations, floors, walls, partitions, doors, and lockers.

**36K584 Maintenance - Operating procedures/Manufacturers' instructions**

<b>POINTS</b> <b>1</b>	Compliance Date: <b>Not Specified</b>	<b>Inspector Comments:</b> Observed pool operating procedure, and manufacturer's instructions for mechanical and electrical equipment missing. Maintain all documents for review at time of inspection.
	<b>Not In Compliance</b>	
	Violation Reference - <b>HSC - 65521</b>	

**Violation Description:** The pool operator shall maintain pool operating procedures at the public pool site for use by the pool operator and for inspection by the enforcing agent.  
The pool operator shall maintain manufacturers' instructions for the operation and maintenance for all mechanical and electrical equipment and water treatment systems at the public pool site for use by the pool operator and for inspection by the enforcing agent.

**Overall Inspection Comments**

No summary comments have been made for this inspection.

**Signature(s) of Acknowledgement**

SNA

NAME: signature not available  
TITLE:

Total # of Images: 0