

WATER QUALITY MANAGEMENT PLAN

For compliance with State Water Resources Control Board
Water Quality Order No. 2003-0005-DWQ (NPDES Permit No. CAS000004)

For
Eum's Commercial Development
9722 Phelan Road,
Oak Hills, CA

Prepared for:
David Eum
626 S. Plymouth Blvd.,
Los Angeles, CA 90005
Tel: (213) 248-0815
APN: 3064-041-02-0000

Prepared By:
Trans American Engineering
10410 Lower Azusa Road, Suite 202
El Monte, CA 91731
Tel: (626)527-3888

WQMP Preparation Date
August 8, 2012

WATER QUALITY MANAGEMENT PLAN

Determination of Project Category

Check the appropriate project category below:

Check Below	Category
	1. New development and/or redevelopment of any commercial or industrial property that creates, adds and/or replaces 100,000 square feet or more of impervious surface. Redevelopment is any land-disturbing activity that results in the creation, addition or replacement of exterior impervious surface area on a previously developed site
	2. New development and/or redevelopment of Automotive repair shops (with SIC codes 5013, 5014, 5541, 7532 - 7534, 7536 - 7539) that creates, adds and/or replaces 5,000 square feet or more of impervious surface.
	3. New development and/or redevelopment of a Retail Gasoline Outlet (RGOs) that creates, adds and/or replaces 5,000 square feet or more of impervious surface.
	4. New development and/or redevelopment of a Restaurant that creates and/or replaces 5,000 square feet or more of impervious surface
✓	5. New development and/or redevelopment of an uncovered parking lot that creates, adds and/or replaces 5,000 square feet or more of impervious surface, or provides 25 parking spaces exposed to storm water runoff. Parking lot is defined as land area or facility for the temporary storage of motor vehicles.
	6. New development and/or redevelopment of a Single Family Hillside residences.
	7. New development and/or redevelopment project that creates a home subdivision comprised of 10 or more housing units. This category includes developments on public or private land that fall under the planning and building authority of the County.
	8. The project does not fall into any of the categories described above. It is therefore defined as a Non-Category Project. NOTE: <i>Emergency public safety projects in any of the above-listed categories shall be excluded from the WQMP requirement, if the delay caused due to the WQMP requirement compromises public safety, public health, and / or environmental protection</i>

WATER QUALITY MANAGEMENT PLAN

Project Site Information

Name of Project: Eum's Commercial Development

Project Location: 9722 Phelan Road, Oak Hills, CA

Size of Significant Re-Development on an Already Developed Site (in feet²): 102,835.52

Size of New Development (in feet²): 102,835.52

Number of Home Subdivisions: Zero

SIC Codes: _____

Erosive Site Conditions?: No

Natural Slope More Than 25%?: No

Section 1

Introduction and Project Description

1.1 Project Information

David Eum
626 S. Plymouth Blvd. Los Angeles, CA 90005
Tel: (213) 248-0815
9722 Phelan Road, Oak Hills, CA

1.2 Permits

APN: 3064-041-02
Project No.: P201200202

1.3 Project Description

The project is located on the northeast corner of Phelan Road and Baldy Mesa Road. The site is currently occupied by one residential structure and is approximately 2.36 acres. It will be a commercial development that includes three office buildings and one fast food restaurant with drive thru.

1.4 Site Description

Existing drainage pattern is northeasterly towards the Mojave River.

Table 2-1

Pollutants of Concern for Project Categories and Land Uses

Project Categories/ Land Uses	Bacteria / Virus (Pathogens)	Heavy Metals	Nutrients / Noxious Aquatic Plants	Pesticides / PCBs	Organic Compounds	Sediments / Turbidity / Suspended Solids / pH	Trash & Debris	Oxygen Demanding Substances	Oil & Grease
Industrial/Commercial New or Redevelopment (≥100,000 sf)	P ⁽³⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁵⁾	P ⁽¹⁾	E	P ⁽¹⁾	E
Automotive Repair Shops (≥5,000 sf)	N	P	N	N	E ^(4,5)	N	E	N	E
Retail Gasoline Outlets (≥5,000 sf)	N	E	N	N	E	N	E	P ⁽¹⁾	E
Restaurants (≥5,000 sf)	E	N	N	N	N	N	E	E	E
Uncovered Parking Lots (≥5,000 sf or ≥ 25 parking spaces)	P ⁽⁶⁾	E	P ⁽¹⁾	P ⁽¹⁾	E ⁽⁴⁾	P ⁽¹⁾	E	P ⁽¹⁾	E
Hillside Residential Development	E	N	E	E	N	E	E	P ⁽¹⁾	P ⁽²⁾
Residential Development (≥10 detached units)	E	N	E	E	N	E	E	E	P ⁽²⁾
Residential Development (≥10 attached units)	P	N	E	E	N	E	E	P ⁽¹⁾	P ⁽²⁾
Streets/Highways/Freeways	P ⁽⁶⁾	E	P ⁽¹⁾	P ⁽¹⁾	E ⁽⁴⁾	E	E	P ⁽¹⁾	E

KEY:

E = Expected P = Potential N = Not expected

Notes:

- (1) A potential pollutant if landscaping or open area exists on the Project site.
- (2) A potential pollutant if the project includes uncovered parking areas.
- (3) A potential pollutant if the land use involves animal waste.
- (4) Specifically, petroleum hydrocarbons.
- (5) Specifically, solvents.
- (6) Bacterial indicators are routinely detected in pavement runoff.

Section 2
Pollutants of concern

2.1 Pollutants of Concern (NOT REQUIRED FOR NON-CATEGORY PROJECTS)

Pollutant of Concern Summary Table

Pollutant Type	Expected	Potential	Listed for Receiving Water
Bacteria / Virus (Pathogens)		✓	
Metals	✓		
Nutrients / Noxious Aquatic Plants		✓	
Pesticides / PCB		✓	
Organic Compounds	✓		
Sediments / Turbidity / Total Suspended Solids / pH		✓	
Trash & Debris	✓		
Oxygen Demanding Substances		✓	
Oil & Grease	✓		
Other—specify pollutant(s):			

Section 3 Best Management Practice Selection Process

3.1 Site Design BMPs

For listed Site Design BMPs, indicate in the following table whether it will be used (yes/no) and describe how used, or, if not used, provide justification/alternative. Provide detailed descriptions of planned Site Design BMPs, if applicable.

1. Minimize Storm water Runoff, Minimize Project's Impervious Footprint, and Conserve Natural Areas	
Maximize the permeable area. This can be achieved in various ways, including but not limited to, increasing building density (number of stories above or below ground) and developing land use regulations seeking to limit impervious surfaces.	
<input checked="" type="radio"/> Yes	<input type="radio"/> No
Describe actions taken or justification/alternative: <i>THERE IS MORE THAN 14,000 FT² OF LANDSCAPED AREA</i>	
Runoff from developed areas may be reduced by using alternative materials or surfaces with a lower Coefficient of Runoff, or "C-Factor".	
<input type="radio"/> Yes	<input checked="" type="radio"/> No
Describe actions taken or justification/alternative:	
Conserve natural areas. This can be achieved by concentrating or clustering development on the least environmentally sensitive portions of a site while leaving the remaining land in a natural, undisturbed condition.	
<input type="radio"/> Yes	<input checked="" type="radio"/> No
Describe actions taken or justification/alternative:	

Construct walkways, trails, patios, overflow parking lots, alleys, driveways, low-traffic streets, and other low-traffic areas with open-jointed paving materials or permeable surfaces, such as pervious concrete, porous asphalt, unit pavers, and granular materials.

Yes

No

Describe actions taken or justification/alternative:

Construct streets, sidewalks, and parking lot aisles to the minimum widths necessary, provided that public safety and a pedestrian friendly environment are not compromised. Incorporate landscaped buffer areas between sidewalks and streets.

Yes

No

Describe actions taken or justification/alternative:

Reduce widths of street where off-street parking is available.

Yes

No

Describe actions taken or justification/alternative:

Maximize canopy interception and water conservation by preserving existing native trees and shrubs, and planting additional native or drought tolerant trees and large shrubs.

Yes

No

Describe actions taken or justification/alternative:

Other comparable site design options that are equally effective.

Yes

No

Describe actions taken or justification/alternative:

Minimize the use of impervious surfaces, such as decorative concrete, in the landscape design.

Yes

No

Describe actions taken or justification/alternative:

Use natural drainage systems.

Yes

No

Describe actions taken or justification/alternative:

Where soils conditions are suitable, use perforated pipe or gravel filtration pits for low flow infiltrations.

Yes

No

Describe actions taken or justification/alternative:

Construct onsite ponding areas, rain gardens, or retention facilities to increase opportunities for infiltration, while being cognizant of the need to prevent the development of vector breeding areas.

Yes

No

Describe actions taken or justification/alternative:

CULTEC STORMWATER CHAMBERS ARE BEING PROPOSED FOR THIS PURPOSE

2. Minimize Directly Connected Impervious Areas

Where landscaping is proposed, drain rooftops into adjacent landscaping prior to discharging to the storm drain.

<input checked="" type="radio"/> Yes	<input type="radio"/> No	
--------------------------------------	--------------------------	--

Describe actions taken or justification/alternative:

Where landscaping is proposed, drain impervious sidewalks, walkways, trails, and patios into adjacent landscaping.

<input checked="" type="radio"/> Yes	<input type="radio"/> No	
--------------------------------------	--------------------------	--

Describe actions taken or justification/alternative:

Increase the use of vegetated drainage swales in lieu of underground piping or imperviously lined swales.

<input checked="" type="radio"/> Yes	<input type="radio"/> No	
--------------------------------------	--------------------------	--

Describe actions taken or justification/alternative:

Use one or more of the following:

Yes	No	Design Feature
	✓	Rural swale system: street sheet flows to vegetated swale or gravel shoulder, curbs at street corners, culverts under driveways and street crossings
	✓	Urban curb/swale system; street slopes to curb; periodic swale inlets drain to vegetated swale/biofilter.
	✓	Dual drainage system: First flush captured in street catch basins and discharged to adjacent vegetated swale or gravel shoulder, high flows connect directly to municipal storm drain systems.
	✓	Other comparable design concepts that are equally effective.

Describe actions taken or justification/alternative:

- 1 Sidewalk widths must still comply with Americans with Disabilities Act regulations and other life safety requirements.
- 2 However, street widths must still comply with life safety requirements for fire and emergency vehicle access.
- 3 However, projects must still comply with hillside grading ordinances that limit or restrict infiltration of runoff. Infiltration areas may be subject to regulation as Class V injection wells and may require a report to the USEPA. Consult the Agency for more information on use of this type of facility.
- 4 Rainfall analysis to develop regression coefficients in Table D-1 and modifications to the NOAA Atlas 14 map were conducted by:

Hromadka II, T.V., Professor Emeritus, Department of Mathematics, California State University, Fullerton, and Adjunct Professor, Department of Mathematical Sciences, United States Military Academy, West Point, NY

Laton, W.R., Assistant Professor, Department of Geological Sciences, California State University, Fullerton

Picciuto J.A., Assistant Professor, Department of Mathematical Sciences, United States Military Academy, West Point, NY

With assistance from:

Rene Perez, M.S. Candidate, Department of Geological Sciences, California State University, Fullerton, and

Jim Friel, Ph.D. Professor Emeritus, Department of Mathematics, California State University, Fullerton

Reported as follows:

1. Hromadka II, T.V., Laton, W.R., and Picciuto J.A., 2005. Estimating Runoff Quantities for Flow and Volume-based BMP Design. Final Report to the San Bernardino County Flood Control District.
2. Laton, W.R., Hromadka II, T.V., and Picciuto J.A., 2005. Estimating Runoff Quantities for Flow and Volume-based BMP Design (submitted). Journal of the American Water Resources Association.

Use one or more of the following features for design of driveways and private residential parking areas:		
Yes	No	Design Feature
	✓	Design driveways with shared access, flared (single lane at street) or wheel strips (paving only under tires); or, drain into landscaping prior to discharging to the municipal storm drain system.
	✓	Uncovered temporary or guest parking on private residential lots may be paved with a permeable surface; or designed to drain into landscaping prior to discharging to the municipal storm drain system.
✓		Other comparable design concepts that are equally effective.
Describe actions taken or justification/alternative: <i>CULTEC STORMWATER CHAMBERS ARE PROPOSED TO HANDLE ALL DRAINAGE</i>		
Use one or more of the following design concepts for the design of parking areas:		
Yes	No	Design Feature
✓		Where landscaping is proposed in parking areas, incorporate landscape areas into the drainage design.
	✓	Overflow parking (parking stalls provided in excess of the Agency's minimum parking requirements) may be constructed with permeable paving.
	✓	Other comparable design concepts that are equally effective.
Describe actions taken or justification/alternative:		

3.2 Source Control BMPs

Project Category	Education of Property Owners	Activity Restrictions	Spill Contingency Plan	Employee Training/Education Program	Street Sweeping Private Street and Parking Lots	Common Areas Catch Basin Inspection	Landscape Planning (SD-10)	Hillside Landscaping	Roof Runoff Controls (SD-11)	Efficient Irrigation (SD-12)	Protect Slopes and Channels	Storm Drain Signage (SD-13)	Inlet Trash Racks	Energy Dissipaters	Trash Storage Areas (SD-32) and Litter Control	Fueling Areas (SD-30)	Air/Water Supply Area Drainage	Maintenance Bays and Docks (SD-1)	Vehicle Washing Areas (SD-33)	Outdoor Material Storage Areas (SD-34)	Outdoor Work Areas (SD-35)	Outdoor Processing Areas (SD-36)	Wash Water Controls for Food Preparation Areas	Pervious Pavement (SD-20)	Alternative Building Materials (SD-21)
Industrial / Commercial New or Redevelopment (>100,000 ft ²)																									
Automotive Repair Shops (>5,000 ft ²)																									
Retail Gasoline Outlets (>5,000 ft ²)																									
Restaurants (>5,000 ft ²)																									
Uncovered Parking Lots (>5,000 ft ² or >25 parking spaces)	✓	✓	✓	✓	✓	✓	✓		✓	✓		✓	✓		✓										
Hillside Residential New or Redevelopment																									
Residential New or Redevelopment (>10 housing units)																									

* Provide justification of each Source Control BMP that will not be incorporated in the project WQMP, or explanation of proposed equally effective alternatives in the following table

Justification for Source Control BMPs not incorporated into the project WQMP			
Source Control BMP	Used in Project (yes/no)?	Justification/Alternative*	Implementation Description
Education of Property Owners	YES		
Activity Restrictions	YES		
Spill Contingency Plan	YES		
Employee Training/Education Program	YES		
Street Sweeping Private Street and Parking Lots	YES		
Common Areas Catch Basin Inspection	YES		
Landscape Planning (SD-10)	YES		
Hillside Landscaping	NO	N/A	
Roof Runoff Controls (SD-11)	YES		
Efficient Irrigation (SD-12)	YES		
Protect Slopes and Channels	NO	N/A	
Storm Drain Signage (SD-13)	YES		
Inlet Trash Racks	YES		
Energy Dissipaters	NO	N/A	
Trash Storage Areas (SD-32) and Litter Control	YES		
Fueling Areas (SD-30)	NO	N/A	
Air/Water Supply Area Drainage	NO	N/A	
Maintenance Bays and Docks (SD-31)	NO	N/A	
Vehicle Washing Areas (SD-33)	NO	N/A	
Outdoor Material Storage Areas (SD-34)	NO	N/A	
Outdoor Work Areas (SD-35)	NO	N/A	
Outdoor Processing Areas (SD-36)	NO	N/A	
Wash Water Controls for Food Preparation Areas	YES		
Pervious Pavement (SD-20)	NO	CURB CHANNELS ARE BEING PROVIDED INSTEAD	
Alternative Building Materials (SD-21)	NO	N/A	
*Attach additional sheets if necessary for justification.			

3.3 Treatment Control BMPs (Not required for Non-Category projects)

Complete the following Treatment Control BMPs Selection Matrix. For each pollutant of concern enter "yes" if identified in Section 2.1, above, or "no" if not identified for the project. Check the boxes of selected BMPs that will be implemented for the project to address each pollutant of concern from the project as listed above in section 2.1. Treatment Control BMPs must be selected and installed with respect to identified pollutant characteristics and concentrations that will be discharged from the site. For any identified pollutants of concern not listed in the Treatment Control BMP Selection Matrix, provide an explanation of how they will be addressed by Treatment Control BMPs. For identified pollutants of concern that are causing an impairment in receiving waters (as identified in Section 2.1, above), the project WQMP shall incorporate one or more Treatment Control BMPs of medium or high effectiveness in reducing those pollutants. It is the responsibility of the project proponent to demonstrate, and document in the project WQMP, that all pollutants of concern will be fully addressed. The Agency may require information beyond the minimum requirements of this WQMP to demonstrate that adequate pollutant treatment is being accomplished.

In addition to completing the Selection Matrix, provide detailed descriptions on the location, implementation, installation, and long-term O&M of planned Treatment Control BMPs.

3.4 BMP Design Criteria

The following Treatment Control BMP(s) (Flow Based or Volume Based) will be implemented for this project (*check "Implemented" box, if used*):

Design Basis of Treatment Control BMPs		
Implemented	Treatment Control BMP	Design Basis
	Vegetated Buffer Strips	Flow Based
✓	Vegetated Swale	
	Multiple Systems	
	Manufactured/Proprietary	
	Bioretention	Volume Based
	Wet Pond	
	Constructed Wetland	
	Extended Detention Basin	
	Water Quality Inlet	
	Retention/Irrigation	
	Infiltration Basin	
	Infiltration Trench	
	Media Filter	
✓	Manufactured/Proprietary	

✓ CULTEC STORMWATER CHAMBERS

3.4.1 Flow Based Design Criteria

Calculate the BMP design flow by using the method described in Attachment D, Section A. Show calculations in detail - attach a separate sheet of calculations.

VEGETATED SWALES AND LANDSCAPED AREAS WILL SERVE AS ADDITIONAL BMP'S. THE MAIN TREATMENT CONTROL BMP FOR THIS PROJECT WILL BE THE CULTEC STORMWATER CHAMBERS.

3.4.2 Volume-Based Design Criteria

Calculate the required capture volume of the BMP using the method described in Attachment D, Section B. Show calculations in detail - attach a separate sheet of calculations.

Section 4 Operation and Maintenance

4.1 Operations and Maintenance

Operation and maintenance (O&M) requirements for all Source Control, Site Design, and Treatment Control BMPs shall be identified within the WQMP. The WQMP shall include the following:

4.1.1 O&M Description and Schedule:

List and identify each BMP that requires O&M.

Provide a thorough description of O&M activities (include the O&M process, and the handling and placement of any wastes).

Include BMP start-up dates.

Provide a schedule of the frequency of O&M for each BMP.

4.1.2 Inspection & Monitoring Requirements:

Provide thorough descriptions of water quality monitoring (if locally required).

Provide self-inspections and record keeping requirements for BMPs (review local specific requirements regarding self-inspections and/or annual reporting), including identification of responsible parties for inspection and record keeping.

4.1.3 Identification of Responsible Parties:

Provide the party or parties that will be responsible for each BMP O&M. For each responsible party, include the party's name, address, contact name and telephone number.

Section 5 Funding

5.1 Funding

The Permit requires that for all Treatment Control BMPs, a funding source or sources for operation and maintenance of each BMP be identified within the WQMP. Project proponents must:

Indicate funding sources or sources for O&M for this project. For each funding source, include the responsible party's name, address, contact name and telephone number.

The following chart indicates the Source Control (Non-Structural) BMPs will be implemented at this site:

BMP I.D. #	BMP Description	Description of BMP and Method of Implementation	BMP Responsibility
N1	Education for Property Owners, Tenant and Occupants	The owner will familiarize himself with the information included in Attachment on this report and will take responsibility for the implementation of the Best Management Practices outlined in the attachment. In addition to the attachments, the following resources can be contacted to obtain updated educational information and pertinent ordinances free of charge:	Owners'
N2	Activity restrictions	<p>The following is a list of activity restrictions for the project site and will be listed in leasing agreement:</p> <ul style="list-style-type: none"> • No changing of oil or other auto repairs will be permitted on the premises. • On-site cleaning of trash dumpsters with water is prohibited • Do not sweep grass clippings, dead leaves into infiltration trenches, or other landscaping related debris into infiltration trenches. • Do not perform paint cleanup activities in paved areas or allow rinse water from these activities to enter the storm drain system or gutter. Clean brushes containing water-based paint in a sink that is connected to the sanitary sewer system. • Do not use detergents or other chemical additives when washing concrete sidewalks or building exteriors, use potable water only and collect wash water runoff using a vacuum truck, for proper offsite disposal. • Do not allow washwater from concrete, mortar or other construction activities to enter the storm drain system or gutter. • Keep premises, as well as trash container areas, free of litter. • No structure and any landscape feature will be allowed or place on top of the infiltration trench. Any modification on the infiltration will require amending the WQMP. <p>Activity restriction will be placed in the lease agreement</p>	Owners'

Post Construction Source Control (Non-Structural) BMP Implementation (continued)

Complete the following chart by indicating which Source Control (Non-Structural) BMPs will be implemented at this site:

BMP I.D. #	BMP Description	Description of BMP and Method of Implementation	BMP Responsibility
N3	Landscape Management	Irrigation systems shall be installed and programmed to apply proper volume of water and avoid excess runoff. Mow, weed and trim vegetation are to be placed in appropriate containers (Bi weekly). Landscapping & related irrigation will be routinely inspected once per week for damage and/or disease, and maintained according to an executed landscape maintenance contract. All damage and/or diseased plant material and irrigation equipment will be replaced/repared within 15 days.	Owners ¹
N4	Common Area Litter control	Regular maintenance will be conducted, consisting, at a minimum of cleaning the site. All litter will be removed on a weekly basis	Owners ¹
N5	Employee Training	Once an employee is hired and every once in a year, the owner will give a copy of the educational material attached at appendix D and remind the employee that storm drain is for storm water only. Also the Owner/management will hold a yearly seminar/training for the employees regarding stormwater pollution prevention.	Owners ¹
N6	Street Sweeping Private street and Parking lot	Parking lot will be sweep quarterly, especially prior to storm season during late summer to early fall. Rainy Season start around October 15 up to April 15	Owners ¹

Post Construction Source (Structural) BMP Installation

Complete the following chart by indicating which Structural BMPs will be installed at this site and provide (attach) a site map locating structural BMPs as well as a detail drawing of each BMP which will be constructed to reduce storm water pollution after construction is complete.

BMP I.D. #	BMP Description	Description of BMP including dimensions, details, make & model, etc.	Maintenance Responsibility	Funding Source For O & M	Maintenance Schedule
SD-13	Stormdrain Signage	The phrase "NO DUMPING – DRAINS TO OCEAN" or equally effective phrase shall be stenciled on catch basins in the parking lots to alert the public and employees to the destination of pollutants discharged into the storm drain system.	Owners ¹	Owners ¹	During Original installation and yearly
S2	Efficient Irrigation	Irrigation systems shall be installed and programmed to apply proper volume of water and avoid excess runoff. An Irrigation Management Plan shall be implemented to verify the following at a minimum: <ul style="list-style-type: none"> • Irrigation heads are adjusted properly to eliminate over-spray to hardscape areas; • Irrigation timing and cycle lengths are adjusted in accordance with water demands, time of year, weather, and day or nighttime temperatures; and <p>The maintenance shall consist of inspection of sprinkler heads, irrigation timing cycle, replacing, repairing, or adjusting as necessary.</p>	Owners ¹	Owners ¹	Weekly

Post Construction Treatment (Structural) BMP Installation (cont.)

Complete the following chart by indicating which Structural BMPs will be installed at this site and provide (attach) a site map locating structural BMPs as well as a detail drawing of each BMP which will be constructed to reduce storm water pollution after construction is complete.

BMP I.D. #	BMP Description	Description of BMP including dimensions, details, make & model, etc.	Maintenance Responsibility	Funding Source For O & M	Maintenance Schedule
S6	Trash Container Areas	Trash container area will have drainage from adjoining roofs and pavements diverted around the area. Dumpster shall be leak proof and have attached workable covers. Keep lid closed all the time and remove debris around the container and within enclosure every two weeks.	Owners ¹	Owners ¹	On-going

**Section 6
WQMP Certification**

6.1 Certification

"This Water Quality Management Plan has been prepared for (Owner/Developer Name) by (Consulting /Engineering Firm Name). It is intended to comply with the requirements of the City of (name city or county) for Tract/Parcel Map No. _____, Condition Number(s) _____ requiring the preparation of a Water Quality Management Plan (WQMP). The undersigned is aware that Best Management Practices (BMPs) are enforceable pursuant to the City's/County's Water Quality Ordinance No. 3587. The undersigned, while it owns the subject property, is responsible for the implementation of the provisions of this plan and will ensure that this plan is amended as appropriate to reflect up-to-date conditions on the site consistent with the Phase II permit and the intent of the water quality regulations applicable to for San Bernardino County areas within the Lahontan Region. Once the undersigned transfers its interest in the property, its successors in interest and the city/county shall be notified of the transfer. The new owner will be informed of its responsibility under this WQMP. A copy of the approved WQMP shall be available on the subject site in perpetuity. "

"I certify under a penalty of law that the provisions (implementation, operation, maintenance, and funding) of the WQMP have been accepted and that the plan will be transferred to future successors."

Applicant's Signature

Date

Applicant's Name

Applicant's Telephone Number

Attachment A-1

Maintenance Mechanisms

A-1.1 The Agency shall not accept storm water structural BMPs as meeting the WQMP requirements standard, unless an O&M Plan is prepared (see WQMP Section 4.1) and a mechanism is in place that will ensure ongoing long-term maintenance of all structural and non-structural BMPs. This mechanism can be provided by the Agency or by the project proponent. As part of project review, if a project proponent is required to include interim or permanent structural and non-structural BMPs in project plans, and if the Agency does not provide a mechanism for BMP maintenance, the Agency shall require that the applicant provide verification of maintenance requirements through such means as may be appropriate, at the discretion of the Agency, including, but not limited to covenants, legal agreements, maintenance agreements, conditional use permits and/or funding arrangements.

A-1.2 Maintenance Mechanisms

1. **Public entity maintenance:** The Agency may approve a public or acceptable quasi-public entity (e.g., the County Flood Control District, or annex to an existing assessment district, an existing utility district, a state or federal resource agency, or a conservation conservancy) to assume responsibility for operation, maintenance, repair and replacement of the BMP. Unless otherwise acceptable to individual Agencies, public entity maintenance agreements shall ensure estimated costs are front-funded or reliably guaranteed, (e.g., through a trust fund, assessment district fees, bond, letter of credit or similar means). In addition, the Permittees may seek protection from liability by appropriate releases and indemnities.

The Agency shall have the authority to approve storm water BMPs proposed for transfer to any other public entity within its jurisdiction before installation. The Permittee shall be involved in the negotiation of maintenance requirements with any other public entities accepting maintenance responsibilities within their respective jurisdictions; and in negotiations with the resource agencies responsible for issuing permits for the construction and/or maintenance of the facilities. The Agency must be identified as a third party beneficiary empowered to enforce any such maintenance agreement within their respective jurisdictions.

2. **Project proponent agreement to maintain storm water BMPs:** The Agency may enter into a contract with the project proponent obliging the project proponent to maintain, repair and replace the storm water BMP as necessary into perpetuity. Security or a funding mechanism with a "no sunset" clause may be required.

3. **Assessment districts:** The Agency may approve an Assessment District or other funding mechanism created by the project proponent to provide funds for storm water BMP maintenance, repair and replacement on an ongoing basis. Any agreement

with such a District shall be subject to the Public Entity Maintenance Provisions above.

4. **Lease provisions:** In those cases where the Agency holds title to the land in question, and the land is being leased to another party for private or public use, the Agency may assure storm water BMP maintenance, repair and replacement through conditions in the lease.

5. **Conditional use permits:** For discretionary projects only, the Agency may assure maintenance of storm water BMPs through the inclusion of maintenance conditions in the conditional use permit. Security may be required.

6. **Alternative mechanisms:** The Agency may accept alternative maintenance mechanisms if such mechanisms are as protective as those listed above.

Attachment A-2

INSTRUCTIONS FOR COMPLETING THE WATER QUALITY MANAGEMENT PLAN (WQMP) TRANSFER, ACCESS, AND MAINTENANCE AGREEMENT

In order for your project to receive approval, you will need to prepare a WQMP and Storm water Best Management Practices Transfer, Access and Maintenance Agreement (Maintenance Agreement). ***Please contact the Department of Public Works, Environmental Management Division after the final WQMP is approved, and at least ten (10) business days prior to your project's construction being completed, to receive the current Maintenance Agreement template. You can contact the Environmental Management Division by phone, by calling (909) 387 – 8109, or by email, at evarga@dpw.sbcounty.gov.*** The Maintenance Agreement shall be completed and approved according to the procedure outlined below, and must include the following information and attachments:

1. Provide all written information requested in the Maintenance Agreement template, including project and property owner's signature(s).

2. Attach a legal description of the project location, as well as a legal description of the locations of where all proposed storm water Best Management Practices will be constructed / installed, including a listing of the applicable Assessor's Parcel Numbers (APN). This page will be labeled as "EXHIBIT A, LEGAL DESCRIPTION".

3. Attach an 8.5" x 11" or 8.5" x 14" sized project plan sheet (labeled as "EXHIBIT B, BMP SITE PLAN"), illustrating the proposed storm water Best Management Practices and maintenance / access points. Cross sections and other pertinent details of such measures shall also be included. (Plan should be legible)

4. Attach a completed Notary page, with notary's wet seal affixed, and **having the following statement inserted on the Notary page:**

"FOR: Maintenance Agreement, dated _____, for the project known as _____ (APN _____), as described in the WQMP dated _____."

5. Attach a copy of the cover sheet for the most current WQMP that was approved. The cover sheet must display the information that is requested in the most current WQMP Guidance and Template document. Please visit the Environmental Management Division's website for the current WQMP Guidance and Template document (http://www.sbcounty.gov/dpw/land/environmental_mgmt.asp).

6. The completed Maintenance Agreement (along with attachments) shall be submitted for review to:

Department of Public Works
Environmental Management Division
825 E. Third Street, Room 201
San Bernardino, CA 92415-0835

7. Staff at the Environmental Management Division will review the Maintenance Agreement, and request any necessary changes.

8. When the Maintenance Agreement has been approved, the project and property owner(s) must sign the Maintenance Agreement and have his / her signature notarized.

9. The Maintenance Agreement will then be returned to the Environmental Management Division, where appropriate staff will obtain the notarized signature of the Director of Public Works (this may take up to ten (10) business days, depending on the Director's schedule and availability of the notary). Please provide a telephone number where you can be reached when the Maintenance Agreement is ready to be picked up for you to record.

Please Note: The Director of Public Works will not sign the Maintenance Agreement until the proposed Best Management Practices, as documented in the project WQMP, are constructed / installed, and all outstanding charges and invoices are paid.

10. The fully executed Maintenance Agreement must now be recorded at the San Bernardino County Recorder's Office at:

222 W. Hospitality Lane (behind the Souplantation restaurant)
San Bernardino, CA 92415-0018

11. A photocopy of the final recorded Maintenance Agreement must be returned to the Environmental Management Division. You must also show the recorded Maintenance Agreement to the Land Development Division of the Department of Public Works, in order to receive their final approval on your project.

If during project construction, there are any field changes to the storm water Best Management Practices and maintenance / access points proposed in the WQMP, then the WQMP must be revised and re-submitted for approval by the County, and a new Maintenance Agreement must also be completed and re-submitted for approval by the County, according to the procedure outlined above.

If you have any further questions about this process, please call the Environmental Management Division, County Storm Water Program, at (909) 387-8109.

RECORDING REQUESTED BY:

County of San Bernardino
Department of Public Works

AND WHEN RECORDED MAIL TO:

County of San Bernardino
Department of Public Works
825 E. Third Street, Room 201
San Bernardino, CA 92415-0835

SPACE ABOVE THIS LINE FOR RECORDER'S USE

AGREEMENT

THIS PAGE ADDED TO PROVIDE ADEQUATE SPACE FOR RECORDING
INFORMATION (Additional Recording Fees Apply)

**Water Quality Management Plan and Storm Water Best Management Practices
Transfer, Access and Maintenance Agreement**

OWNER NAME : _____

PROPERTY ADDRESS: _____

APN: _____

THIS AGREEMENT is made and entered into in

_____, California, this _____ day of

_____, by and between

_____, hereinafter

referred to as Owner, and the COUNTY OF SAN BERNARDINO, a municipal corporation, located in the County of San Bernardino, State of California, hereinafter referred to as County;

WHEREAS, the Owner owns real property ("Property") in the County of San Bernardino, State of California, more specifically described in Exhibit "A" and depicted in Exhibit "B", each of which exhibits is attached hereto and incorporated herein by this reference;

WHEREAS, at the time of initial approval of development project known as

_____ within the Property described herein, the County required the project to employ Best Management Practices, hereinafter referred to as "BMPs," to minimize pollutants in urban runoff;

WHEREAS, the Owner has chosen to install and/or implement BMPs as described in the Water Quality Management Plan, on file with the County, hereinafter referred to as "WQMP", to minimize pollutants in urban runoff and to minimize other adverse impacts of urban runoff;

WHEREAS, said WQMP has been certified by the Owner and reviewed and approved by the County;

WHEREAS, the Owner is aware that periodic and continuous maintenance, including, but not necessarily limited to, filter material replacement and sediment removal, is required to assure peak performance of all BMPs in the WQMP and that, furthermore, such maintenance activity will require compliance with all Local, State, or Federal laws and regulations, including those pertaining to confined space and waste disposal methods, in effect at the time such maintenance occurs;

NOW THEREFORE, it is mutually stipulated and agreed as follows:

1. All maintenance or replacement of BMPs proposed as part of the WQMP are the sole responsibility of the Owner in accordance with the terms of this Agreement.
2. Owner hereby provides the County of San Bernardino's designee complete access, of any duration, to the BMPs and their immediate vicinity at any time, upon reasonable notice, or in the event of emergency, as determined by the County Director of Public Works, no advance notice, for the purpose of inspection, sampling, testing of the Device, and in case of emergency, to undertake all necessary repairs or other preventative measures at owner's expense as provided in paragraph 3 below. The County shall make every effort at all times to minimize or avoid interference with Owner's use of the Property. Denial of access to any premises or facility that contains WQMP features is a violation of the County Storm Water Ordinance, County Code 3587. If there is reasonable cause to believe that an illicit discharge or breach of the WQMP operation and maintenance commitments is occurring on the premises then the authorized enforcement agency may seek issuance of a search warrant from any court of competent jurisdiction in addition to other enforcement actions.
3. Owner shall use its best efforts diligently to maintain all BMPs in a manner assuring peak performance at all times. All reasonable precautions shall be exercised by Owner and Owner's representative or contractor in the removal and extraction of any material(s) from the BMPs and the ultimate disposal of the material(s) in a manner consistent with all relevant laws and regulations in effect at the time. As may be requested from time to time by the County, the Owner shall provide the County with documentation identifying the material(s) removed, the quantity, and disposal destination.
4. In the event Owner, or its successors or assigns, fails to accomplish the necessary maintenance contemplated by this Agreement, within five (5) days of being given written notice by the County, the County is hereby authorized to cause any maintenance necessary to be done and charge the entire cost and expense against the property and/or to the Owner or Owner's successors or assigns, including administrative costs, attorneys fees and interest thereon at the maximum rate authorized by the County Code from the date of the notice of expense until paid in full.
5. The County may require the owner to post security in form and for a time period satisfactory to the County to guarantee the performance of the obligations stated herein. Should the Owner fail to perform the obligations under the Agreement, the County may, in the case of a cash bond, act for the Owner using the proceeds from it, or in the case of a surety bond, require the sureties to perform the obligations of the Agreement. As an additional remedy, the Director of Public Works may withdraw any previous storm water-related approval with respect to the property on which BMPs have been installed and/or implemented until such time as Owner repays to County its reasonable costs incurred in accordance with paragraph 3 above.

6. This agreement shall be recorded in the Office of the Recorder of San Bernardino County, California, at the expense of the Owner and shall constitute notice to all successors and assigns of the title to said Property of the obligation herein set forth, and also a lien in such amount as will fully reimburse the County, including interest as herein above set forth, subject to foreclosure in event of default in payment.
7. In event of legal action occasioned by any default or action of the Owner, or its successors or assigns, then the Owner and its successors or assigns agree(s) to hold the County harmless and pay all costs incurred by the County in enforcing the terms of this Agreement, including reasonable attorney's fees and costs, and that the same shall become a part of the lien against said Property.
8. It is the intent of the parties hereto that burdens and benefits herein undertaken shall constitute covenants that run with said Property and constitute a lien there against.
9. The obligations herein undertaken shall be binding upon the heirs, successors, executors, administrators and assigns of the parties hereto. The term "Owner" shall include not only the present Owner, but also its heirs, successors, executors, administrators, and assigns. Owner shall notify any successor to title of all or part of the Property about the existence of this Agreement. Owner shall provide such notice prior to such successor obtaining an interest in all or part of the Property. Owner shall provide a copy of such notice to the County at the same time such notice is provided to the successor.
10. Time is of the essence in the performance of this Agreement.
11. Any notice to a party required or called for in this Agreement shall be served in person, or by deposit in the U.S. Mail, first class postage prepaid, to the address set forth below. Notice(s) shall be deemed effective upon receipt, or seventy-two (72) hours after deposit in the U.S. Mail, whichever is earlier. A party may change a notice address only by providing written notice thereof to the other party.
12. The Owner its successors and assigns, hereby agrees to save and hold harmless the County, any of its departments, agencies, officers or employees, all of whom while working within their respective authority, from all cost, injury and damage incurred by any of the above, and from any other injury or damage to any person or property whatsoever, any of which is caused by an activity, condition or event arising out of the performance, preparation for performance or nonperformance of any provision of this agreement by the Owner, its agents, or any of its independent contractors.

[REMAINDER OF THIS PAGE INTENTIONALLY LEFT BLANK]

IF TO COUNTY :

IF TO OWNER:

Director of Public Works

825 E. Third Street, Room 201

San Bernardino, CA 92415-0835

IN WITNESS THEREOF, the parties hereto have affixed their signatures as of the date first written above.

OWNER:

Signature: _____

Name: _____

Title

OWNER:

Signature: _____

Name: _____

Title

NOTARIES ON FOLLOWING PAGE

A notary acknowledgement is required for recordation (attach appropriate acknowledgement).

ACCEPTED BY:

GERRY NEWCOMBE, Director of Public Works

Date: _____


Attachment: Standard Notary Acknowledgement

EXHIBIT A
(Legal Description)

EXHIBIT B
(Map/illustration)

1

BMP SITE PLAN

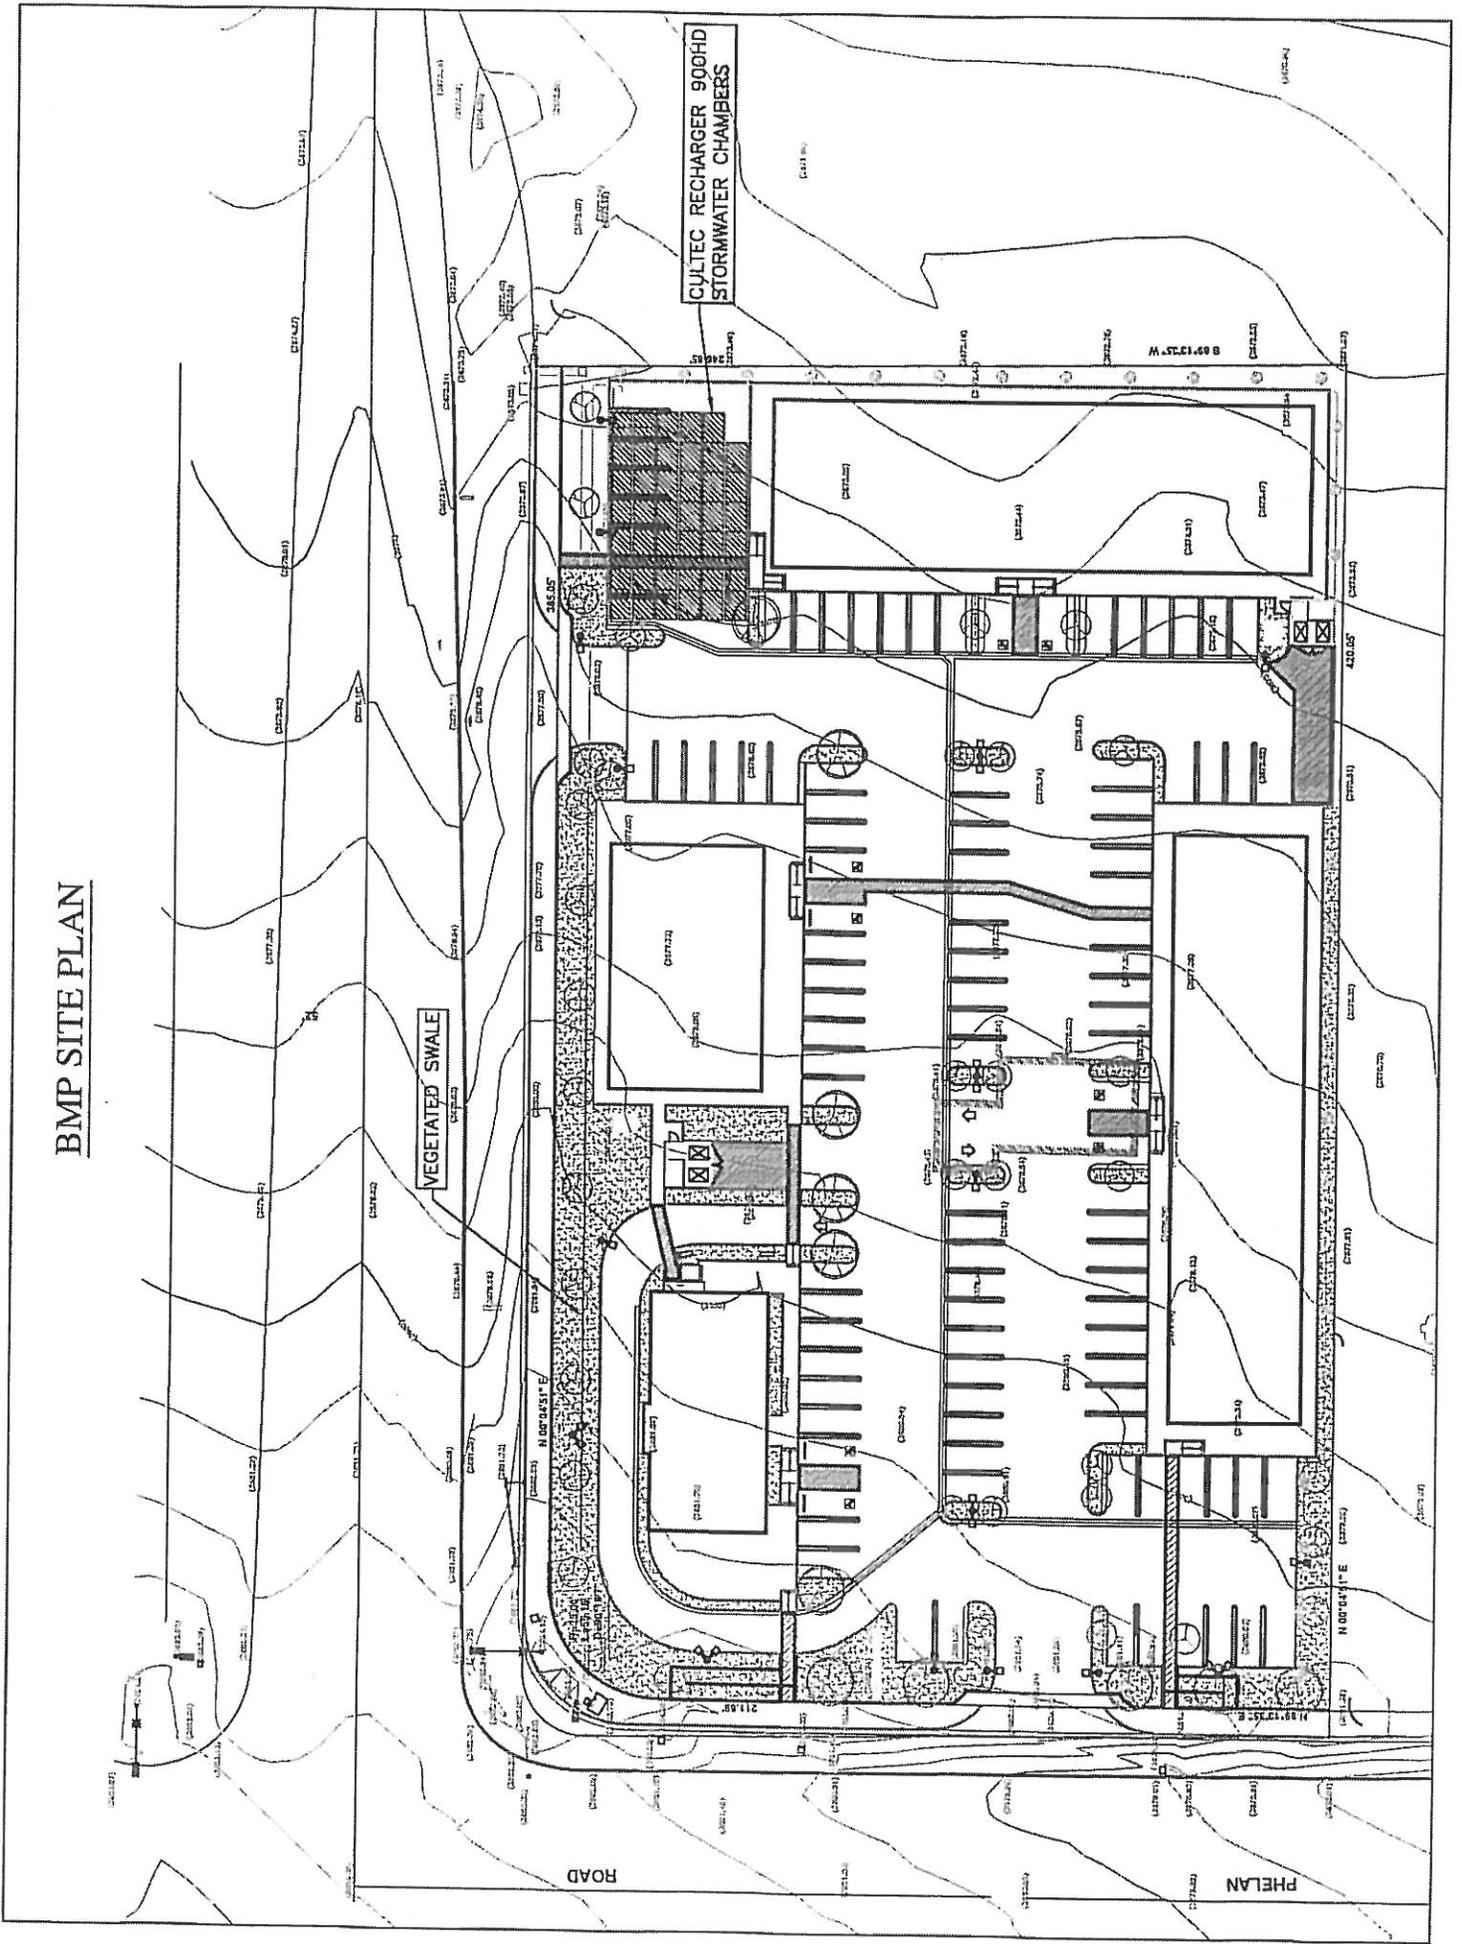

Attachment B Tables
Revised April 12, 2012

Table B-2
C Values Based on Impervious/Pervious Area Ratios

% Impervious	% Pervious	C
0	100	0.15
5	95	0.19
10	90	0.23
15	85	0.26
20	80	0.30
25	75	0.34
30	70	0.38
35	65	0.41
40	60	0.45
45	55	0.49
50	50	0.53
55	45	0.56
60	40	0.60
65	35	0.64
70	30	0.68
75	25	0.71
80	20	0.75
85	15	0.79
90	10	0.83
95	5	0.86
100	0	0.90

NOTE:

Obtain individual runoff coefficient C-Factors from the local agency or from the local flood control district.

If C-Factors are not available locally, obtain factors from hydrology text books or estimate using this table.

Composite the individual C-Factors using area-weighted averages to calculate the Composite C Factor for the area draining to a treatment control BMP.

Do not use the C-Factors in this table for flood control design or related work.

Attachment C
Pollutants of Concern

Pollutants of Concern

Bacteria / Viruses (Pathogens) – Bacteria and Viruses are ubiquitous microorganisms that thrive under certain environmental conditions. Their proliferation is typically caused by the transport of animal or human fecal wastes from the watershed. Water, containing excessive bacteria and viruses, can alter the aquatic habitat and create a harmful environment for humans and aquatic life. Also, the decomposition of excess organic waste causes increased growth of undesirable organisms in the water.

Metals – The primary source of metal pollution in stormwater is typically commercially available metals and metal products. Metals of concern include cadmium, chromium, copper, lead, mercury, and zinc. Lead and chromium have been used as corrosion inhibitors in primer coatings and cooling tower systems. Metals are also raw material components in non-metal products such as fuels, adhesives, paints, and other coatings. At low concentrations naturally occurring in soil, metals may not be toxic. However, at higher concentrations, certain metals can be toxic to aquatic life. Humans can be impacted from contaminated groundwater resources, and bioaccumulation of metals in fish and shellfish. Environmental concerns, regarding the potential for release of metals to the environment, have already led to restricted metal usage in certain applications (OC 2003).

Nutrients – Nutrients are inorganic substances, such as nitrogen and phosphorus. Excessive discharge of nutrients to water bodies and streams causes eutrophication, where aquatic plants and algae growth can lead to excessive decay of organic matter in the water body, loss of oxygen in the water, release of toxins in sediment, and the eventual death of aquatic organisms. Primary sources of nutrients in urban runoff are fertilizers and eroded soils.

Noxious Aquatic Plants – Noxious aquatic plants are invasive plants; with respect to a particular ecosystem that is not found in the ecosystem and whose presence in the environment causes economic or environmental harm or harm to human health.

Pesticides -- Pesticides (including herbicides) are chemical compounds commonly used to control nuisance growth or prevalence of organisms. Relatively low levels of the active component of pesticides can result in conditions of aquatic toxicity. Excessive or improper application of a pesticide may result in runoff containing toxic levels of its active ingredient (OC 2003).

Polychlorinated Bi-Phenyls (PCB) - PCB are synthetic chemicals that were manufactured for use in various industrial and commercial applications - including oil in electrical and hydraulic equipment, and plasticizers in paints, plastics and rubber products - because of their non-flammability, chemical stability, high boiling point and

electrical insulation properties. When released into the environment, PCBs do not easily break apart. Instead, they persist for many years, bioaccumulate and bioconcentrate in organisms. The EPA has classified PCBs as probable human carcinogens. Long-term effects of PCB exposure include harm to the nervous and reproductive system, immune system suppression, hormone disruption and skin and eye irritation.

Organic Compounds – Organic compounds are carbon-based. Commercially available or naturally occurring organic compounds are found in pesticides, solvents, and hydrocarbons. Organic compounds can, at certain concentrations, indirectly or directly constitute a hazard to life or health. When rinsing off objects, toxic levels of solvents and cleaning compounds can be discharged to storm drains. Dirt, grease, and grime retained in the cleaning fluid or rinse water may also adsorb levels of organic compounds that are harmful or hazardous to aquatic life (OC 2003).

Sediments – Sediments are solid materials that are eroded from the land surface. Sediments can increase turbidity, clog fish gills, reduce spawning habitat, lower young aquatic organisms survival rates, smother bottom dwelling organisms, and suppress aquatic vegetation growth.

Total Suspended Solids (TSS) - The measure of the suspended solids in a water sample includes inorganic substances, such as soil particles and organic substances, such as algae, aquatic plant/animal waste, particles related to industrial/sewage waste, etc. These solids can increase turbidity, clog fish gills, reduce spawning habitat, lower young aquatic organisms survival rates, smother bottom dwelling organisms, and suppress aquatic vegetation growth.

pH – pH is an expression of hydrogen ion concentration in water. pH affects most chemical and biological processes in water, and it is one of the most important environmental factors limiting the distribution of species in aquatic habitats. Different species flourish within different ranges of pH, with the optima for most aquatic organisms falling between pH 6.5-8. U.S. EPA water quality criteria for pH in freshwater suggest a range of 6.5 to 9. Fluctuating pH or sustained pH outside this range reduces biological diversity in streams because it physiologically stresses many species and can result in decreased reproduction, decreased growth, disease, or death.

Trash and Debris – Trash (such as paper, plastic, polystyrene packing foam, and aluminum materials) and biodegradable organic matter (such as leaves, grass cuttings, and food waste) are general waste products on the landscape. The presence of trash and debris may have a significant impact on the recreational value of a water body and aquatic habitat. Trash impacts water quality by increasing biochemical oxygen demand.

Oxygen-Demanding Substances – This category includes biodegradable organic material as well as chemicals that react with dissolved oxygen in water to form other compounds. Proteins, carbohydrates, and fats are examples of biodegradable organic compounds. Compounds such as ammonia and hydrogen sulfide are examples of oxygen-demanding compounds. The oxygen demand of a substance can lead to depletion of dissolved oxygen in a water body and possibly the development of septic conditions. A reduction of dissolved oxygen is detrimental to aquatic life and can generate hazardous compounds such as hydrogen sulfides.

Oil and Grease – Oil and grease in water bodies decreases the aesthetic value of the water body, as well as the water quality. Primary sources of oil and grease are petroleum hydrocarbon products, motor products from leaking vehicles, esters, oils, fats, waxes, and high molecular-weight fatty acids.

Attachment D
Flow- and Volume-Based BMP
Design Calculations
Revised April 12, 2012

INSTRUCTIONS FOR ESTIMATING VOLUME- AND FLOW-BASED BMP DESIGN RUNOFF QUANTITIES⁴

- 1) Identify the "BMP Drainage Area" that drains to the proposed BMP element. This includes all areas that will drain to the proposed BMP element, including pervious areas, impervious areas, and off-site areas, whether or not they are directly or indirectly connected to the BMP element. Calculate the BMP Drainage Area (A) in acres.
- 2) Outline the Drainage Area on the NOAA Atlas 14 Precipitation Depths (2-year 1hour Rainfall) map (Figure D-1).
- 3) Determine the area-averaged 2-year 1-hour rainfall value for the Drainage Area outlined above. *0.47 in/hr*

~~A. Flow-Based BMP Design~~

- 1) Calculate the composite runoff coefficient, CBMP, as defined in part B.2, below.
- 2) Determine which Region the BMP Drainage Area is located in (Valley, Mountain or Desert).
- 3) Determine BMP design rainfall intensity, IBMP, by multiplying the area-averaged 2-year 1-hour value from the NOAA Atlas 14 map by the appropriate regression coefficient from Table D-1 ("I"), and then multiplying by the safety factor specified in the criteria—usually a factor of 2.

⁴ Rainfall analysis to develop regression coefficients in Table D-1 and modifications to the NOAA Atlas 14 map were conducted by: Hromadka II, T.V., Professor Emeritus, Department of Mathematics, California State University, Fullerton, and Adjunct Professor, Department of Mathematical Sciences, United States Military Academy, West Point, NY

Laton, W.R., Assistant Professor, Department of Geological Sciences, California State University, Fullerton

Piccioto J.A., Assistant Professor, Department of Mathematical Sciences, United States Military Academy, West Point, NY

With assistance from:

Rene Perez, M.S. Candidate, Department of Geological Sciences, California State University, Fullerton, and

Jim Friel, Ph.D. Professor Emeritus, Department of Mathematics, California State University, Fullerton

Reported as follows:

1. Hromadka II, T.V., Laton, W.R., and Piccioto J.A., 2005. Estimating Runoff Quantities for Flow and Volume-based BMP Design. Final Report to the San Bernardino County Flood Control District.
2. Laton, W.R., Hromadka II, T.V., and Piccioto J.A., 2005. Estimating Runoff Quantities for Flow and Volume-based BMP Design (submitted). Journal of the American Water Resources Association.

- 4) Calculate the target BMP flow rate, Q, by using the following formula (see Table D-2 below for limitations on the use of this formula):

$$Q = CBMP \cdot IBMP \cdot A$$

where: Q = flow in ft³/s
IBMP = BMP design rainfall intensity, in inches/hour
A = Drainage Area in acres
CBMP = composite runoff coefficient

Table D-1: Regression Coefficients for Intensity (I) and 6-hour mean storm rainfall (P6).

Quantity	Valley 85% upper confidence limit	Mountain 85% upper confidence limit	Desert 85% upper confidence limit
I	0.2787	0.3614	0.3250
P6	1.4807	1.9090	1.2371

Table D-2: Use of the flow-based formula for BMP Design (CASQA 2003).

BMP Drainage Area (Acres)	Composite Runoff Coefficient, "C"			
	0.00 to 0.25	0.26 to 0.50	0.51 to 0.75	0.76 to 1.00
0 to 25	Caution	Yes	Yes	Yes
26 to 50	High Caution	Caution	Yes	Yes
51 to 75	Not Recommended	High Caution	Caution	Yes
76 to 100	Not Recommended	High Caution	Caution	Yes

If the flow-based BMP formula use case, as determined by Table D-2, shows "Caution," "High Caution," or "Not Recommended," considering the project's characteristics, then the project proponent must calculate the BMP design flow using the unit hydrograph method, as specified in the most current version of the San Bernardino County Hydrology Manual, using the design storm pattern with rainfall return frequency such that the peak one hour rainfall depth equals the 85th-percentile 1-hour rainfall multiplied by two.

102,835.52 TOTAL
 14,331.21 PERVIOUS
 88,504.31 IMPERVIOUS

B. Volume-Based BMP Design

- 1) Calculate the "Watershed Imperviousness Ratio", *i*, which is equal to the percent of impervious area in the BMP Drainage Area divided by 100. *86.06%*
- 2) Calculate the composite runoff coefficient CBMP for the Drainage Area above using the following equation:

$$CBMP = 0.858i^3 - 0.78i^2 + 0.774i + 0.04 = 0.6753$$

where: CBMP = composite runoff coefficient; and,
i = watershed imperviousness ratio.

- 3) Determine which Region the Drainage Area is located in (Valley, Mountain or Desert).
- 4) Determine the area-averaged "6-hour Mean Storm Rainfall", P6, for the Drainage Area. This is calculated by multiplying the area averaged 2-year 1-hour value by the *0.47 x 1.2371* appropriate regression coefficient from Table 1. *0.581*
- 5) Determine the appropriate drawdown time. Use the regression constant *a* = 1.582 for 24 hours and *a* = 1.963 for 48 hours. *Note: Regression constants are provided for both 24 hour and 48 hour drawdown times; however, 48 hour drawdown times should be used in most areas of California. Drawdown times in excess of 48 hours should be used with caution as vector breeding can be a problem after water has stood in excess of 72 hours. (Use of the 24 hour drawdown time should be limited to drainage areas with coarse soils that readily settle and to watersheds where warming may be detrimental to downstream fisheries.) 48 hours*
- 6) Calculate the "Maximized Detention Volume", P0, using the following equation:

$$P0 = a \cdot CBMP \cdot P6$$

where: P0 = Maximized Detention Volume, in inches *0.77*
a = 1.582 for 24 hour and *a* = 1.963 for 48 hour drawdown,
 CBMP = composite runoff coefficient; and, *0.6753*
 P6 = 6-hour Mean Storm Rainfall, in inches *0.581*

- 7) Calculate the "Target Capture Volume", V0, using the following equation:

$$V0 = (P0 \cdot A) / 12$$

where: V0 = Target Capture Volume, in acre-feet *0.15 = 6,530.65 ft³*
 P0 = Maximized Detention Volume, in inches; and, *0.77*
 A = BMP Drainage Area, in acres *2.362*