



PLAN

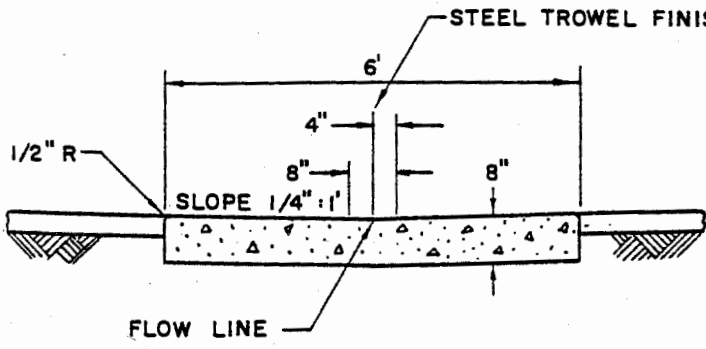

SECTION A-A

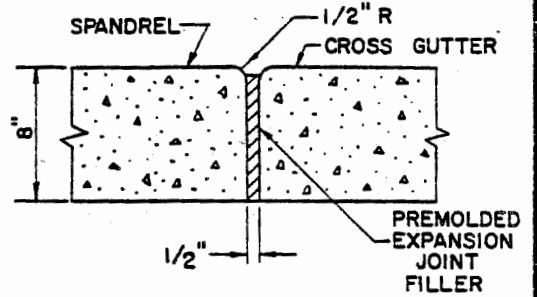

SECTION B-B

**NOTES:**

1. CROSS GUTTER SHALL BE CONSTRUCTED OF CLASS "B" CONCRETE.
2. THE STRAIGHT GRADE BETWEEN B.C.R.'S MAY BE ALTERED ON AN EXCESSIVE GRADE.
3. A 0.3' MINIMUM FALL IS REQUIRED BETWEEN E.C.R. AND CROSS GUTTER FLOWLINE.
4. SPANDREL SHALL BE 8" THICKNESS CLASS "B" CONCRETE.
5. VARIABLE CURB FACE ALLOWED FOR DRAINAGE PURPOSES.

SAN BERNARDINO COUNTY ROAD DEPARTMENT

DATE: 3.V.C. 4-65

M. A. Nicholas  
COUNTY ENGINEER

CROSS GUTTER

119